


FOR PROFILE SEE DRAWING SERIAL 51136A

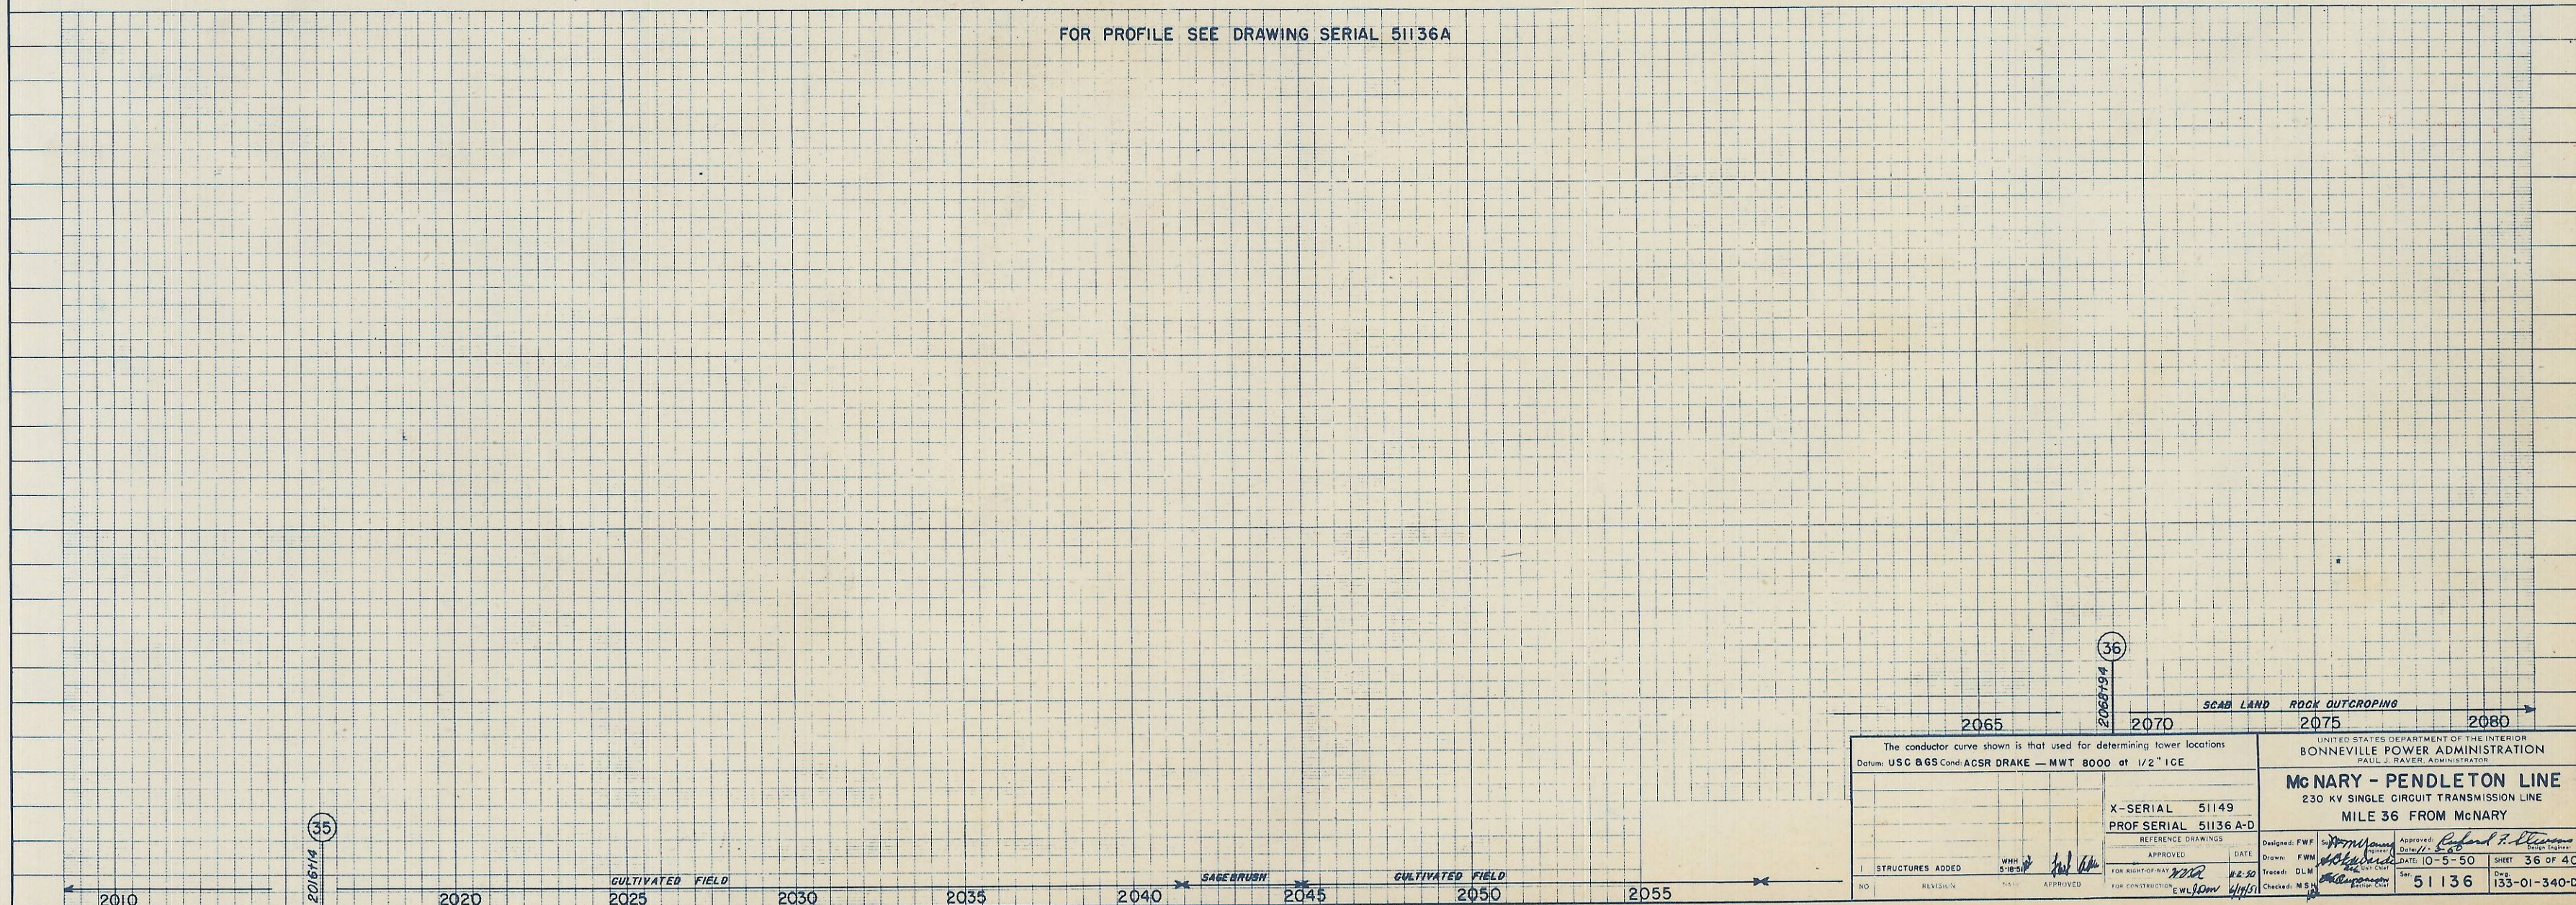

The conductor curve shown is that used for determining tower locations Datum: USC & GS Cond. ACSR DRAKE — MWT 8000 at 1/2" ICE		UNITED STATES DEPARTMENT OF THE INTERIOR BONNEVILLE POWER ADMINISTRATION PAUL J. RAVER, ADMINISTRATOR	
X-SERIAL 51149 PROF SERIAL 51136 A-D		<b>Mc NARY - PENDLETON LINE</b> 230 KV SINGLE CIRCUIT TRANSMISSION LINE MILE 36 FROM McNARY	
DESIGNED: FWF DATE: 10-5-50	DRAWN: FWF DATE: 10-5-50	CHECKED: DLW DATE: 10-5-50	SHEET 36 OF 40 Dwg. No. 133-01-340-D1
APPROVED: <i>[Signature]</i> DATE: 10-5-50		APPROVED: <i>[Signature]</i> DATE: 10-5-50	
FOR RIGHT-OF-WAY: <i>[Signature]</i> DATE: 10-5-50		FOR CONSTRUCTION: <i>[Signature]</i> DATE: 10-5-50	